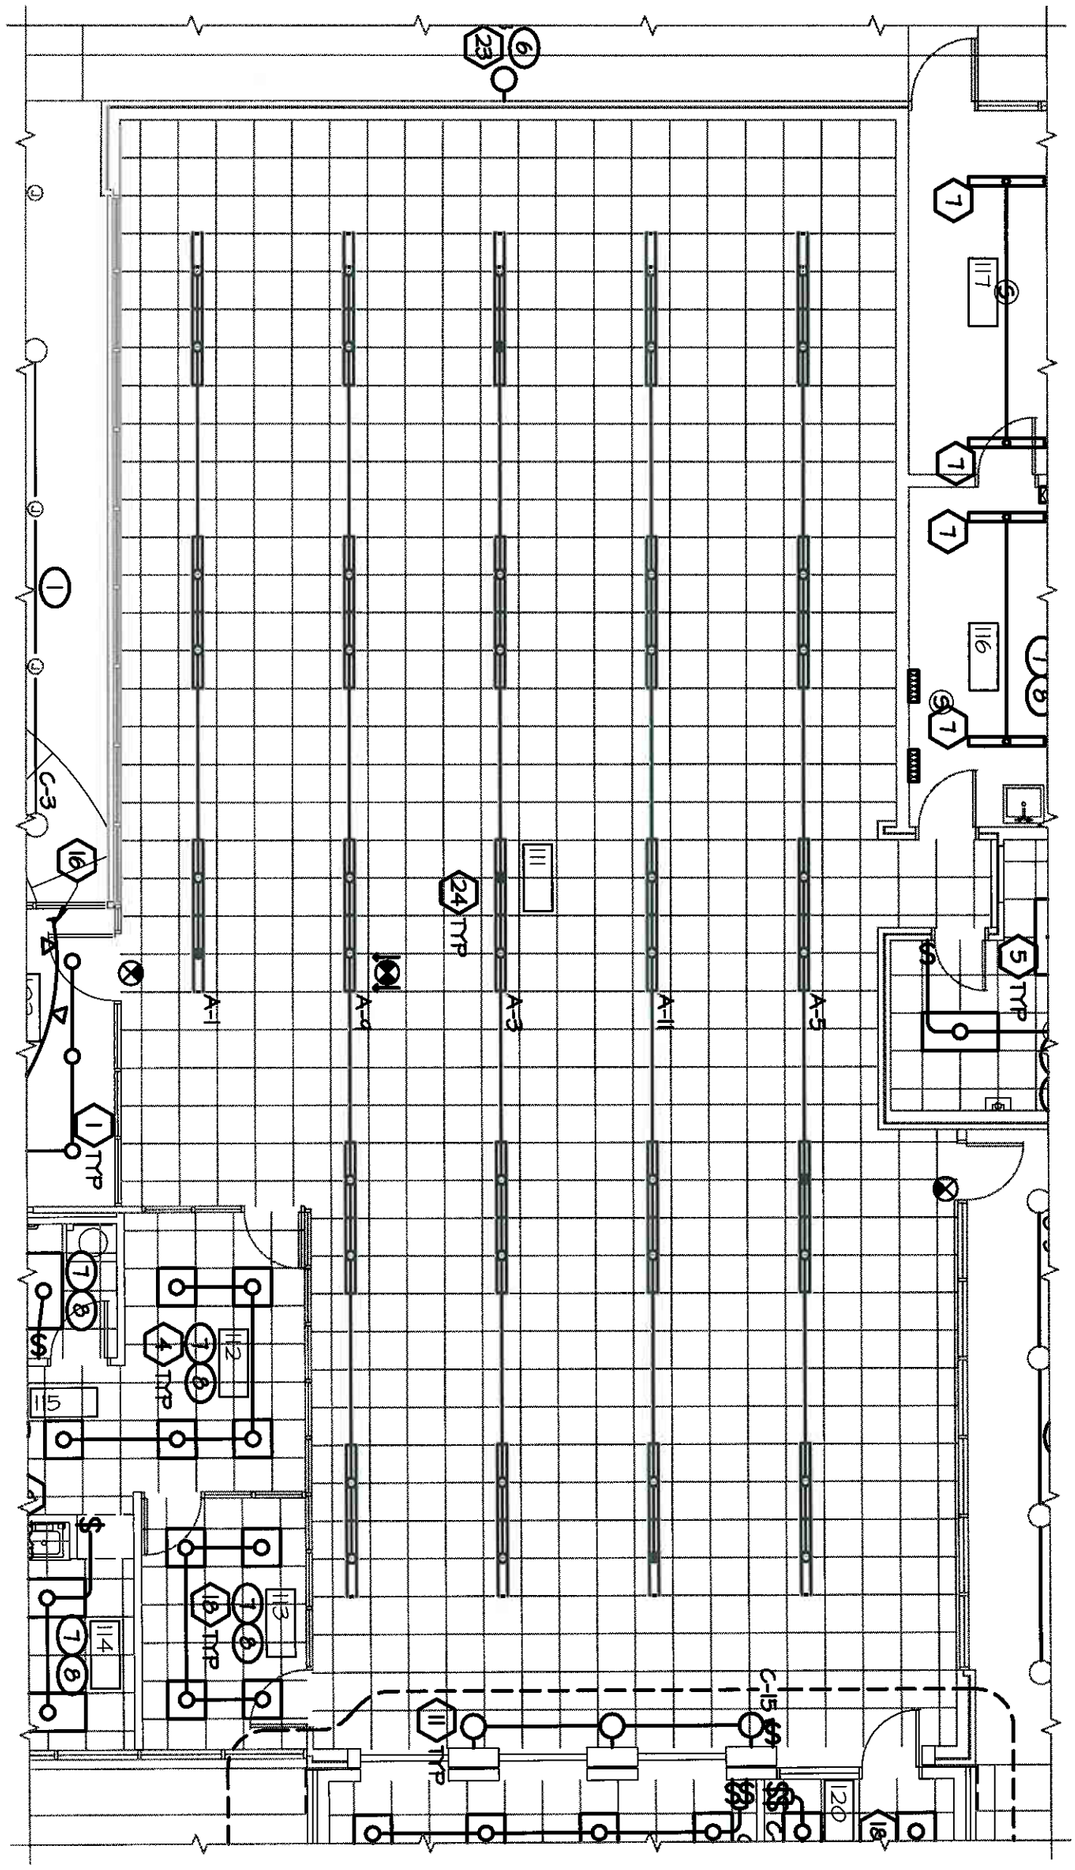

LUMINAIRE TYPE	DESCRIPTION: MANUFACTURER	DESCRIPTION: CATALOG NUMBER	LAMP: QTY	LAMP: NEMA DESIGNATION	LAMP: NOMINAL WATTS	LAMP: INIT LUM	MOUNTING	REMARKS
24	COOPER LIGHTING	CORELITE IQ SE 2T5IC 120AC I5 T1 08	2	T5 HO	54	4500	PENDANT/ CEILING	4 LAMPS PER 8' SECTION

NOTES FOR EXIST STACKS/READING III:

1. OWNER WILL REMOVE CEILING AND ALL EXISTING LIGHT FIXTURES. OWNER WILL TURN OVER EXISTING EXIT LIGHTS TO CONTRACTOR.
2. AFTER OWNER'S CEILING REMOVAL, IMMEDIATELY PROVIDE TEMPORARY LIGHTING AND RE-INSTALL EXIT LIGHTING. DURING INSTALLATION OF FINAL CEILING, REMOVE TEMPORARY LIGHTING AND EXIT LIGHTING AND PROVIDE FINAL LIGHTING. SEE PROJECT MANUAL FOR SCHEDULING OUTAGES.
3. TEMPORARY LIGHTING SHALL BE 50 FOOTCANDLES, INITIAL. PROVIDE 33 FIXTURES, EACH 2 LAMP, 32 WATT, STRIP FIXTURES WITH REFLECTORS OR INDUSTRIAL FIXTURES WITH REFLECTORS, SIMILAR TO LUMINAIRE TYPE 7. FIXTURE LOCATION SHALL BE SIMILAR TO ARRANGEMENT SHOWN ON SUPP. DWG. JP2-4. SUBJECT TO ENGINEER'S APPROVAL, OTHER FIXTURES/ARRANGEMENTS, MEETING 50 FC, MAY BE USED. CONTRACTOR MAY ELECT TO USE FINAL FIXTURES IN LIEU OF TEMPORARY FIXTURES IF DELIVERY CAN BE ARRANGED.
4. SPEAKERS, SMOKE DETECTORS, SECURITY DEVICES, ETC: EXISTING DEVICES WILL REMAIN AFTER CEILING REMOVAL. DURING INSTALLATION OF FINAL CEILING, OWNER WILL RE-INSTALL AND RE-CONNECT DEVICES.

RE: SHEET E1.1

1/8" = 1'-0"

SFCS Architecture Engineering Planning Interiors
SFCS Inc. • 305 South Jefferson Street • Roanoke, Virginia 24011.2003
540.344.6664 • Fax 540.343.6925 • www.sfcs.com

TITLE			
ADD ALTERNATE NO. JP-2			
LIGHTING - EXIST STACKS/READING III			
DRAWN BY	CHECKED BY	DATE	COMM. NO.
JDZ	MWS	11/30/07	6501.06

SUPP. DWG. NO. JP2-4